Amendment to Bid

(Addendum No.:- 1)

(Date of Publication: 8th July, 2022)

Contract No. and Title: PMD/EGMP/GKTLSS-078/79-01: Design, Supply, Installation, Testing and Commissioning of Ghorahi-Khungri (Madichaur) 132 kV Transmission Line and associated Substations at Khungri and Ghorahi.

S. No.	Clause Reference	Existing	Amendment
1	Section 2: BDS: ITB 24.1		The Deadline for the bid submission is Date: 26 th July, 2022 Time: 12:00 Noon (Local Time)
2	Section 3: Evaluation and Qualification criteria: 2.4 Bidder's Experience: 2.4.1 Contracts of Similar Size and Nature		Mentioned Below


Existing clause of S.NO.2:-

Section 3: Evaluation and Qualification criteria:

2.4 Bidder's Experience:

2.4.1 Contracts of Similar Size and Nature

Criteria	Compliance Requirements			Documents	
Requirement	Single	Joint Venture		Submission Requirements	
	All Partners Combined	Each Partner	One Partner		
Participation in at least 2 (two) Contracts that have been successfully or substantially completed within the last 10 (Ten) years and that are similar to the proposed Contract, where the value of the Bidder's participation under each Contract exceeds US\$ 14.35 Million. The similarity of the Bidder's participation		must meet requirement as follows: Either one partner must meet requirement OR any two partners must each demonstrate one (1) successfully or	Must have completed or substantially completed one (1)Contract of design, supply, installation, testing and commissioning of 132 kV or higher voltage	not applicable	Form EXP - 1

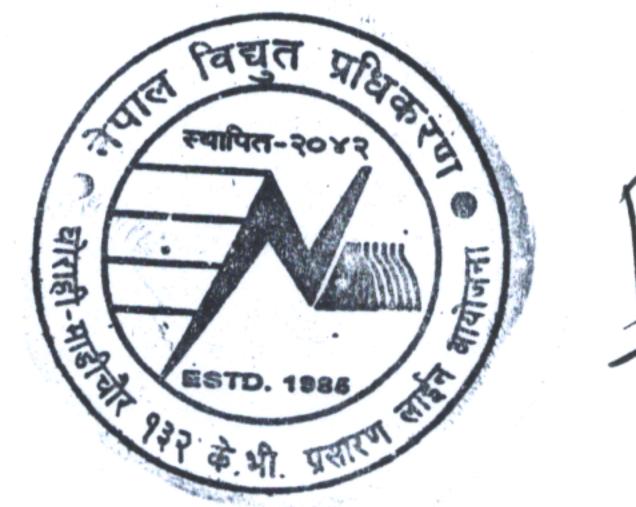

Bachilean

Supply, Installation, Testing and Commissioning of 132 kV or higher voltage overhead Transmission Line and 132 kV or higher voltage Air Insulated Substations (AIS).	completed Contract of design, supply, installation and commissioning of	Line and/or 132 kV or higher voltage Air Insulated Substations in last 10 (ten) Years with contract value not less than US\$ 3.59 Million.
----------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------


After Amendment of S.NO.2:-

Section 3: Evaluation and Qualification criteria:


2.4 Bidder's Experience:

2.4.1 Contracts of Similar Size and Nature

Criteria	Compliance Requirements			Documents	
Requirement	Single			Submission Requirements	
	All Partners Combined	Each Partner	One Partner		
Participation in at least 2 (two) Contracts that have been successfully or substantially completed within the last 10 (Ten) years and that are similar to the proposed Contract, where the value of the Bidder's participation under each Contract exceeds US\$ 14.35 Million. The similarity of the Bidder's participation shall be based on Design, Supply, Installation, Testing and Commissioning of 132 kV or	requirement	must meet requirement as follows: Either one partner must meet requirement OR Any two partners must each demonstrate one (1) successfully or substantially completed Contract	completed or substantially completed one (1)Contract of design, supply, installation, testing and commissioning of 132 kV or higher voltage overhead	not applicable	Form EXP - 1

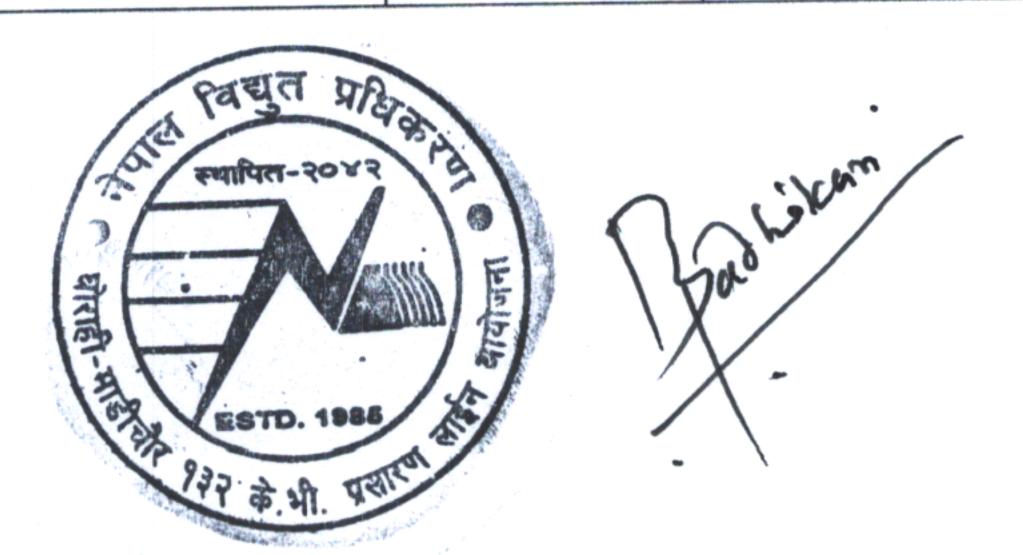

higher voltage overhead	of design, supply,	132 kV or
Transmission Line and/or 132 kV or higher voltage Air Insulated Substations (AIS).	installation and	higher voltage Air Insulated Substations in last 10 (ten) Years with contract value not less than US\$ 3.59 Million.

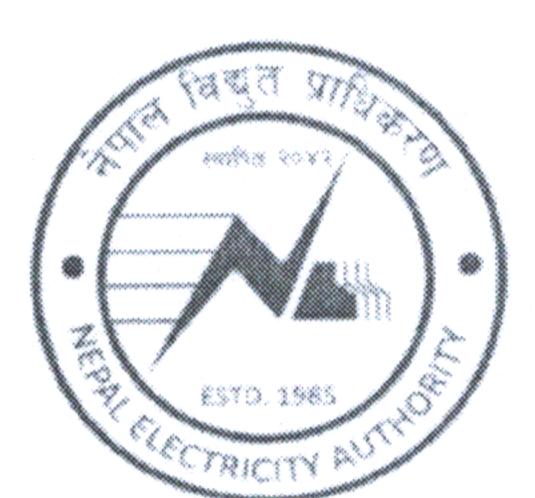

Ghorahi-Madichaur 132 kV Transmission Line Project
Project Management Directorate
Nepal Electricity Authority
NEA Training Center Complex, Kharipati, Bhaktapur, Nepal
Phone No: +977-9851186385

Email Address: gkm132kv@nea.org.np



